


- DATA & SECURITY ROUGH-IN NOTES:**
1. PROVIDE CONDUITS FROM SERVER CHASE TO CAMERA AND DATA OUTLETS AS SHOWN. COORDINATE EXACT LOCATION AND HEIGHT WITH OWNER.
 2. LEAVE PULL STRING IN ALL CONDUITS.
 3. TERMINATE CONDUIT RUNS WITH BUSHINGS.
 4. UNDERGROUND CONDUIT SHALL BE PVC.
 5. PROVIDE LADDER CABLE TRAY IN SERVER CHASE.
 6. PROVIDE 4" X 4" 3/4" FIRE RATED TERMINAL BACKBOARD IN SERVER CHASE. COORDINATE LOCATION AND HEIGHT WITH OWNER.
 7. COORDINATE ALL DATA AND SECURITY ROUGH-IN IN SERVER CHASE WITH PLUMBING PIPING.
 8. PROVIDE BLOCKING FOR CAMERA MOUNTING.
 9. PROVIDE 4" PVC CONDUIT FOR DATA SERVICE ENTRY. EXTEND CONDUIT TO 15' OUTSIDE BUILDING. COORDINATE EXACT LOCATION WITH OWNER OR DESIGNATED DATA SERVICE PROVIDER.


○ DATA & SECURITY ROUGH-IN
3/4" = 1'-0"

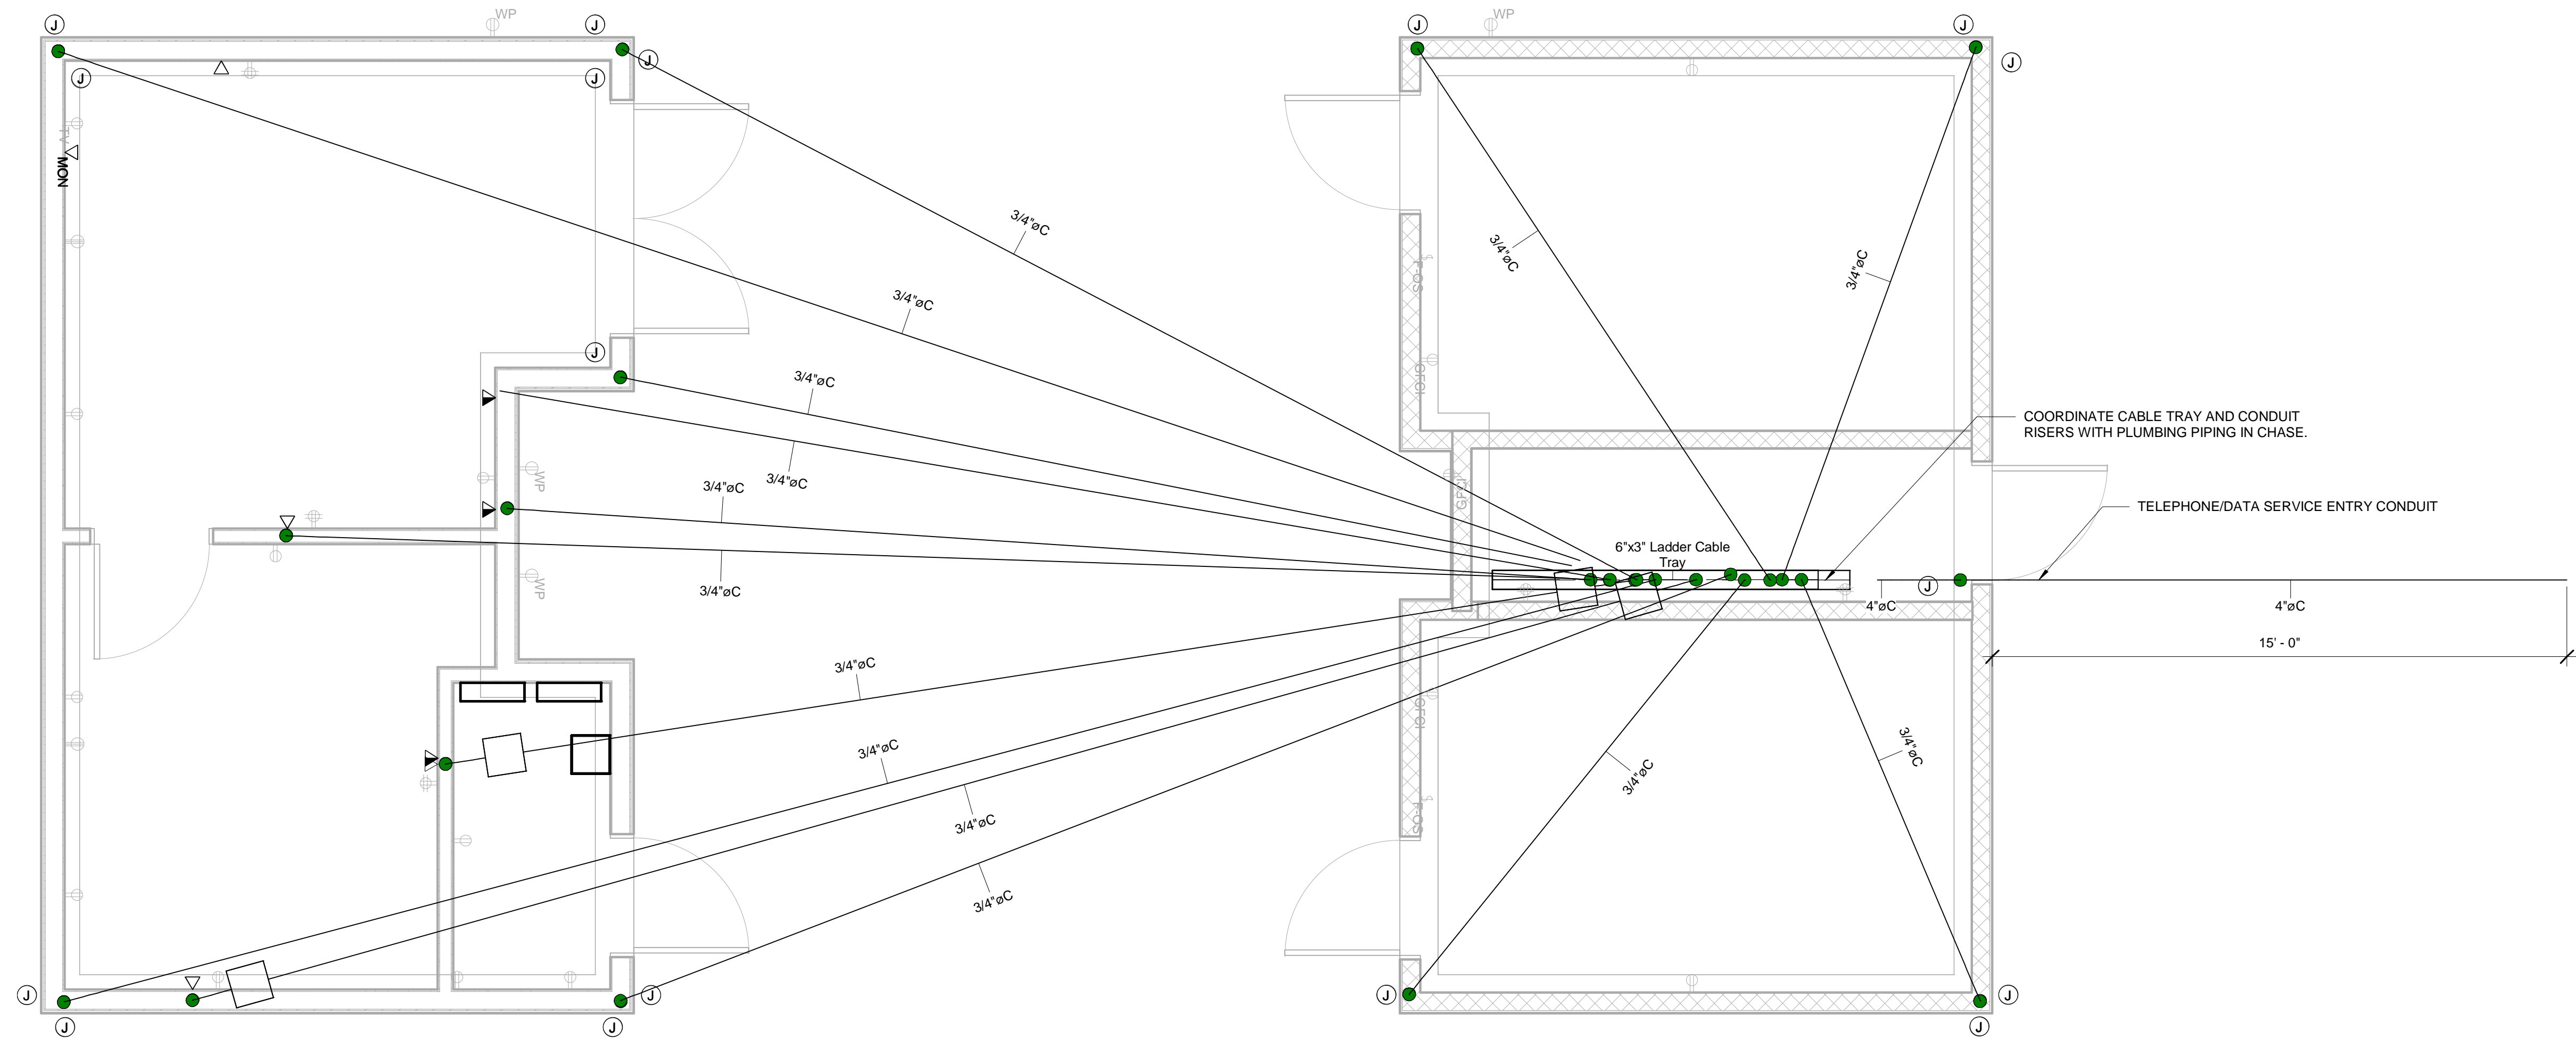

① Underground Conduit Layout
3/8" = 1'-0"

A PROPOSED NEW CONSTRUCTION FOR
THE AMERICAN LEGION PARK
GOLF HOUSE
841 N MILES ST
ELIZABETHTOWN, KY 42701

REVISIONS



DOCUMENT PHASE
CONSTRUCTION
DOCUMENTS
DATE ISSUED
8/15/2017

SHEET NAME
DATA
CONDUIT
LAYOUT

E1.2